


COUNTY

ROUTE

POST MILES TOTAL PROJECT

For details not shown, See Case 1. Level ground ±10% at the traffic side of barrier and sloping ground on the opposite side. BARRIER SECTIONS

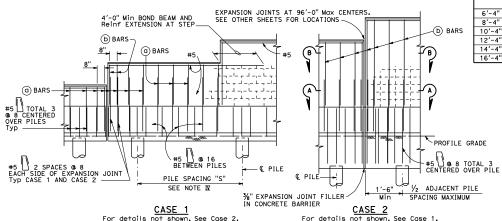

PARTIAL ELEVATIONS

SOUND WALL REINFORCEMENT TABLE

-Approx FINISHED GRADE

-180° HOOKS - Typ TURN HOOKS AS REQUIRED

MORTAR CAP

>(a) BARS [∐

#5 Cont

H=6'-4" THRU H=10'-4"

BOND BEAM AT TOP AND AT 4'-0" MAXIMUM

CENTERS BELOW

8" y 8" y 1'-4" CONCRETÉ BLOCK

#5 Cont AT EACH BOND BEAM 4" WIDE, 2" DEEP OPENING Typ

MAXIMUM H	a BARS & 1'-4" Max	b BARS @ 1'-4" Max	"y"	f'm (psi)	COMPRESSIVE STRENGTH OF CMU (psi)	Н
6'-4"	#4			1500	1900	6'-4"
8'-4"	#4			1500	1900	8'-4"
10'-4"	#4			1500	1900	10'-4"
12'-4"	#5	#4	5′-0"	1500	1900	12'-4"
14'-4"	#6	#4	7′-0"	1500	1900	14'-4"
16'-4"	#6	#4	9'-0"	2500	3750	16'-4"

NOTES I THROUGH XI:

WALL

₽,

Sou

CONCRETE BARRIER TYPE 736 SV

FOR

VARIES

18

LIMITS

- WALL LAYOUT

⊕ BARS []

∫

SEE NOTE III

2" CIr BELOW GROUND

(o)

CASE 2

1'-6"

1'-0"_6"

#5 % @ 8 TOTAL 3 CENTERED OVER PILE

#5 TOTAL 10 IN TYPICAL BARRIER

ADD #5 @ 15 Max AS INDICATED

#5 \ @ 8 TOTAL 3-CENTERED OVER PILE

SLOPE CONTROL POINT

SLOPE SHALL NOT BE STEEPER THAN 2:1

ABOVE GROUND

(a) BARS

#5 % @ 8 TOTAL 3

CENTERED OVER PILE

-#5 \ @ 8 TOTAL 3 CENTERED OVER PILE

NOTE III

PROFILE GRADE

BEND PILE REINF

AS REQUIRED AT FACE OF BARRIER

#5 TOTAL 14

PILE Reinf-

2′-0" 2′-4" 2′-10"

REINF EXTENSIO BARRIER, Typ

PILE

CASE 1

For details not shown, See Case 2, Level ground ±10% on both sides of barrier.

NOTE I

CONCRETE BARRIER TYPE 736 S

- I. Details shown are primarily to conform design of sound walls to Type 736S and Type 736 SV Concrete Barriers. For sound wall details conforming with barriers see Standard Plans B15-7 and B15-8.
- II. For details and sections not shown, see Standard Plans B15-7 and B15-8.
- II. Slope ground at traffic side of barrier to drain.
 Maximum slope ±10%. See Std Plan B11-56, Note 3.
- Pile spacing may be varied, but shall not exceed the tabular values. See Standard Plan B15-8.
- I. For Case 1 ground line to be at the same elevation on both sides of the barrier. Barrier shall not be used to retain earth.
- M. See Standard Plan B15-9 for other details.

- B. When blocks are laid in stacked bond, ladder type, galvanized joint reinforcement shall be provided. A minimum of 2–9 gauge wires continuous at 4'-0" maximum to be used. Locate reinforcement in joints that are at the approximate midpoint between bond beams.
- C. Horizontal joints shall be tooled concave or may be weathered. Vertical joints shall be tooled concave or may be raked.
- D. For intermediate wall heights (H), or barrier depths (H_e), that are between the values given, use the tabular information for the next higher (H) or (H_e).
- E. Concrete to be used for the barrier shall contain not less than 590 pounds of cementitious material per cubic yard.
- F. Masonry strengths are listed in the "SOUND WALL REINFORCEMENT TABLE".

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION

SOUND WALL MASONRY BLOCK ON TYPE 736S/SV BARRIER DETAILS (1)

NO SCALE

RSP B15-6 DATED OCTOBER 19, 2012 SUPERSEDES STANDARD PLAN B15-6 DATED MAY 20, 2011 - PAGE 320 OF THE STANDARD PLANS BOOK DATED 2010.

REVISED STANDARD PLAN RSP

D

AN

RS

v

5

6